



ऑयल एण्ड नेचुरल गैस कॉर्पोरेशन लिमिटेड
OIL AND NATURAL GAS CORPORATION LTD.

ANK/FS/QHSE/F4

अग्निशमन विभाग, अंकलेश्वर परिसम्पति
FIRE SERVICES, ANKLESHWAR ASSET,
अग्निशामक यंत्र परीक्षण रिपोर्ट

FIRE EXTINGUISHER EXAMINATION REPORT

INSTALLATION / RIG/FACILITY CENTRAL SCMTL

DATE: 18/06/2020

SL NO.	TYPE OF FIRE EXTINGUISHERS & CAPACITY	QUANTITY	SERVICE REPORT/SPARES/CONSUMABLE USED/PERFORMANCE TEST DONE.
1	DCP 5 KG & BELOW	05	All Extinguishers checked, cleaned and main done. - 01 CO2 21g replace. - 02 DCP 6kg placed. - HPT. 9.6.20 HPT due - 8.6.25. CSR NO 8260 - HPT 9.6.20 A 8.6.25 CSR NO (385)
2	DCP 9/10 KG		
3	DCP 25 KG		
4	DCP 50 KG		
5	DCP 75 KG		
6	DCP 150 KG		
7	MECH FOAM 9 LTRS		
8	MECH FOAM 50 LTRS		
9	CO2 2.0 KG	05	
10	CO2 3.0 KG	02	
11	CO2 4.5 KG		
12	CO2 6.5 KG	02	
13	CO2 9.0 KG		
14	WATER 9.0 LTRS	07	
15	CLEAN AGENT		

DETAILS OF MAINTENANCE CREW :

SR NO.	NAME	DESIGNATION
1	D. R. Vajand.	SPM TE
2	J. R. Upadga	DO
3		
4		
5		

[Signature]
D. R. Vajand
I/C Crew

[Signature]
Shift I/C

[Signature]
I/c Fire Station



सत्यमेव जयते

INDIA NON JUDICIAL Government of Gujarat

Certificate of Stamp Duty



Certificate No. : IN-GJ56074939359455T

Certificate Issued Date : 05-Jun-2021 11:43 AM

Account Reference : IMPACC (SV)/ gj13039404/ ANKLESHWAR.1/ GJ-BH

Unique Doc. Reference : SUBIN-GJGJ1303940447959916481927T

Purchased by : MANISH JAIN PRINCIPAL KV ONGC

Description of Document : Article 5(h) Agreement (not otherwise provided for)

Description : DECLARATION REGARDING FIRE PROTECTION SYSTEM

Consideration Price (Rs.) : 0
(Zero)

First Party : MANISH JAIN PRINCIPAL KV ONGC


Second Party : Not Applicable

Stamp Duty Paid By : MANISH JAIN PRINCIPAL KV ONGC

Stamp Duty Amount(Rs.) : 300
(Three Hundred only)

Register Serial No. 5559/21
Date - 5 JUN 2021
My Commission Expires 30.06.2025

(Signature)

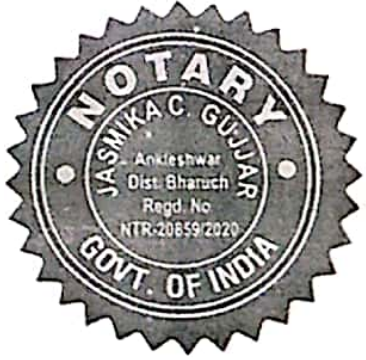


Keep it in Building file very important

0015627493



NOTARIAL
NOTARIAL

NOTARIAL
NOTARIAL

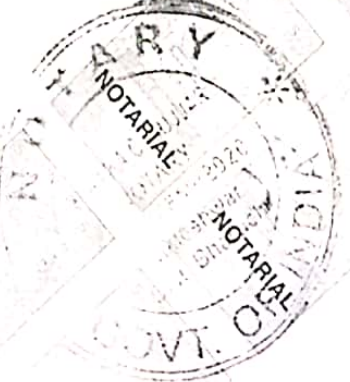

NOTARIAL

NOTARIAL



Warning

"The contents of this certificate can be verified and authenticated world-wide by any members of the public at www.shreestamps.com or at any Authorised collection center address displayed at www.shreestamps.com free of cost."

"Any alteration to this certificate renders it a void document an altered certificate without all the security features could be of no legal importance."

"This document contains security features like colorized background with Lacey Geometric Flexible patterns and subtle color changes. Complex ornamental design borders, Anti-copy test, the appearance of micro printing, artificial watermarks and other Overt and Covert features."



Declaration Regarding Fire Protection System

I MANISH JAIN, Principal KV ONGC, Ankleshwar hereby declare that KV ONGC, Ankleshwar school building is situated at ONGC Colony, Village :- Gadkhol, Ta. Ankleshwar, Dist. Bharuch.


I hereby declare that KV ONGC, Ankleshwar building height is 7.2 meter, which is not Above-9 Meters. So fire noc is not required as per URBAN DEVELOPMENT AND URBAN HOUSING DEPARTMENT Notification Number GH/V/9 of 2021/AGN-102021-100-L-1, Date:- 22 January-2021, However for the fire safety purpose we have strictly followed the requirement of NATIONAL BUILDING CODE OF INDIA PART-4 FIRE AND SAFETY, We have provided in our building Fire Protection System as mentioned below which is as per requirement of NATIONAL BUILDING CODE OF INDIA PART-4 RELATED TO FIRE SAFETY.

- 1.
- 2.

Date : 05/06/2021


.....
Signature

Register Serial No. SSS9/11
Date :- 5 JUN 2021
My Commission Expires on 03-03-2025

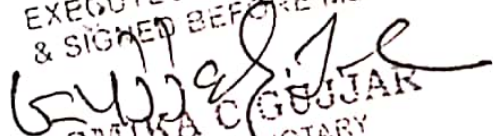BEFORE ME
EXECUTED ACCEPTED
& SIGNED BEFORE ME

JASMIKA C GUJAR
ADVOCATE & NOTARY
NTR / 20859 / 2020
ANKLESHWAR, DI BHARUCH



ऑयल एण्ड नेचुरल गैस कारपोरेशन लि.
OIL AND NATURAL GAS CORPORATION LTD.

अग्निशमन विभाग, अंकलेश्वर परिसम्पति
 FIRE SERVICES, ANKLESHWAR ASSET,
 अग्निशामक यंत्र परीक्षण रिपोर्ट
 FIRE EXTINGUISHER EXAMINATION REPORT

DATE: 20/10/2020

INSTALLATION / RIG/FACILITY _____

SL NO.	TYPE OF FIRE EXTINGUISHERS & CAPACITY	QUANTITY	SERVICE REPORT/SPARES/CONSUMABLE USED/PERFORMANCE TEST DONE.	
1	DCP 6 KG & BELOW	05 Nos.	All fire EXtinguishers are checked, cleaned & Maintenance properly & UP keep in working condition o/c	
2	DCP 9/10 KG	06 Nos.		
3	DCP 25 KG	/		
4	DCP 50 KG			
5	DCP 75 KG			
6	DCP 150 KG			
7	MECH FOAM 9 LTRS			
8	MECH FOAM 50 LTRS			
9	CO2 2.0 KG			05 Nos.
10	CO2 3.0 KG			/
11	CO2 4.5 KG	/		
12	CO2 6.5 KG	02 Nos.		
13	CO2 9.0 KG	/		
14	WATER 9.0 LTRS	06 Nos.		
15	CLEAN AGENT	/		

DETAILS OF MAINTENANCE CREW :

SR NO.	NAME	DESIGNATION
1	Sh. D.R. Valmiki	fm-III
2	Sh. J.R. Murali	fm-III
3	/	
4	/	
5	/	

[Signature]
 I/C Crew 20/10/20

[Signature]
 Shift I/C

I/c Fire Station